



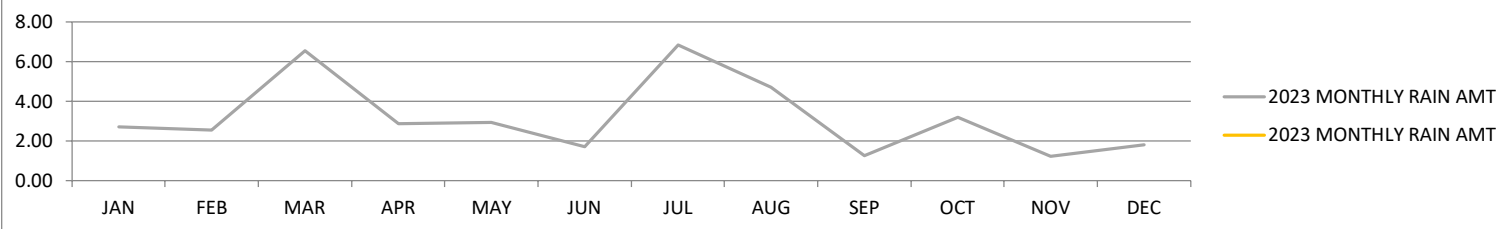

Water Utility

2024 Monthly Report

January

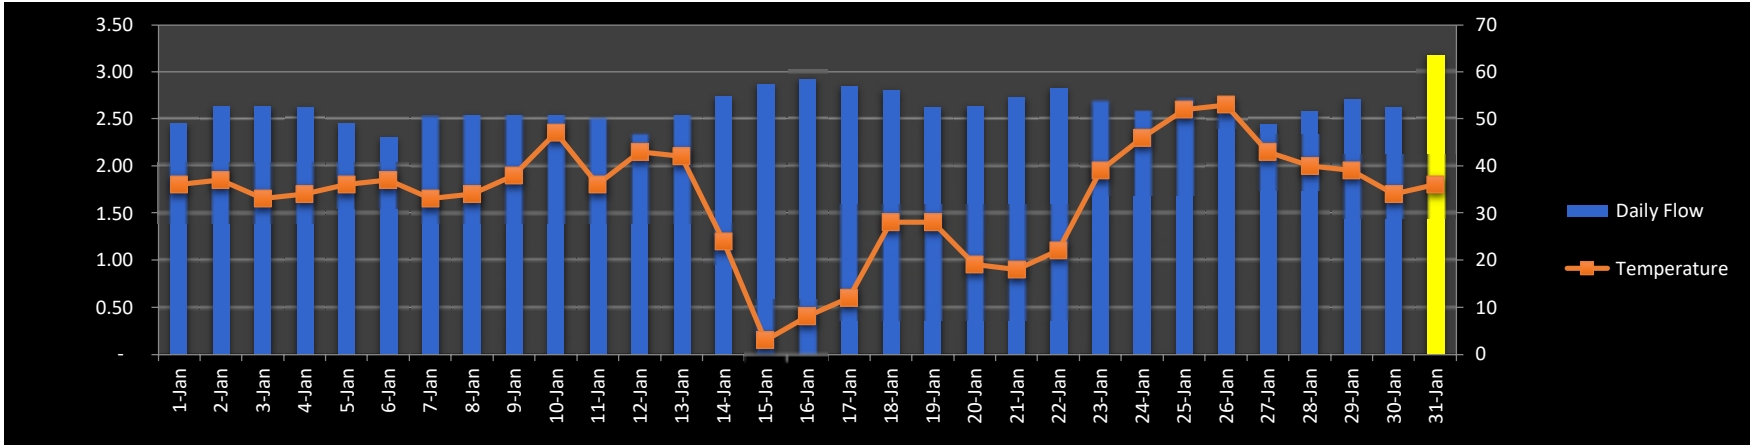

- Normal production
- Single main break / service leak
- Mutiple Main breaks
- Fire
- Flushing
- Drought Condition

Treatment	
Water produced	81.77
Water Sold	60.45
Storage	114%
% Unaccounted	26%
Max Day	2.92
Prev Month customer accts:	9559
Current Month customer accts:	9538
Average distribution chlorine	0.66
Average Distribution Phosphate	1.39
Average Treatment Iron	0.05
Average Treatment Maganese	0.043

OT, non- & Scheduled	
Overtime, Non scheduled	180.50
Overtime, scheduled	66.25
Overtime taken as Comp time	13.00
Non-scheduled OT events	
ECO- Customer Service	24.50
ECO- Distribution	131.25
ECO- Treatment	2.00
Scheduled overtime events	
Distribution Project work	15.75
Plant Operations	50.50
Conference/training	0.00

Work Order summary	
Construction / Repair	10
Hydrant painting	7
GIS Modifications	5
Customer Service Calls	18
Leak Notifications	0
LCRI Identification	8763
Sampling	32
Daily ops tasks	62

Minor generator service
 Well 2-1 changed out psi transducer.
 1st quarter TTHM/HAA5
 Backflow:
 158 actions of communication
 48 testing upcoming notices sent
 34 notices over 90 days pasr due
 Tested 3 devices, all 3 at the NWTP
 7 site visits/inspections.